


NOTES:

1. USE OF LOW EXPANDING FOAM AFTER ELECTRICAL INSTALLATION IS CRITICAL FOR AIR SEALING

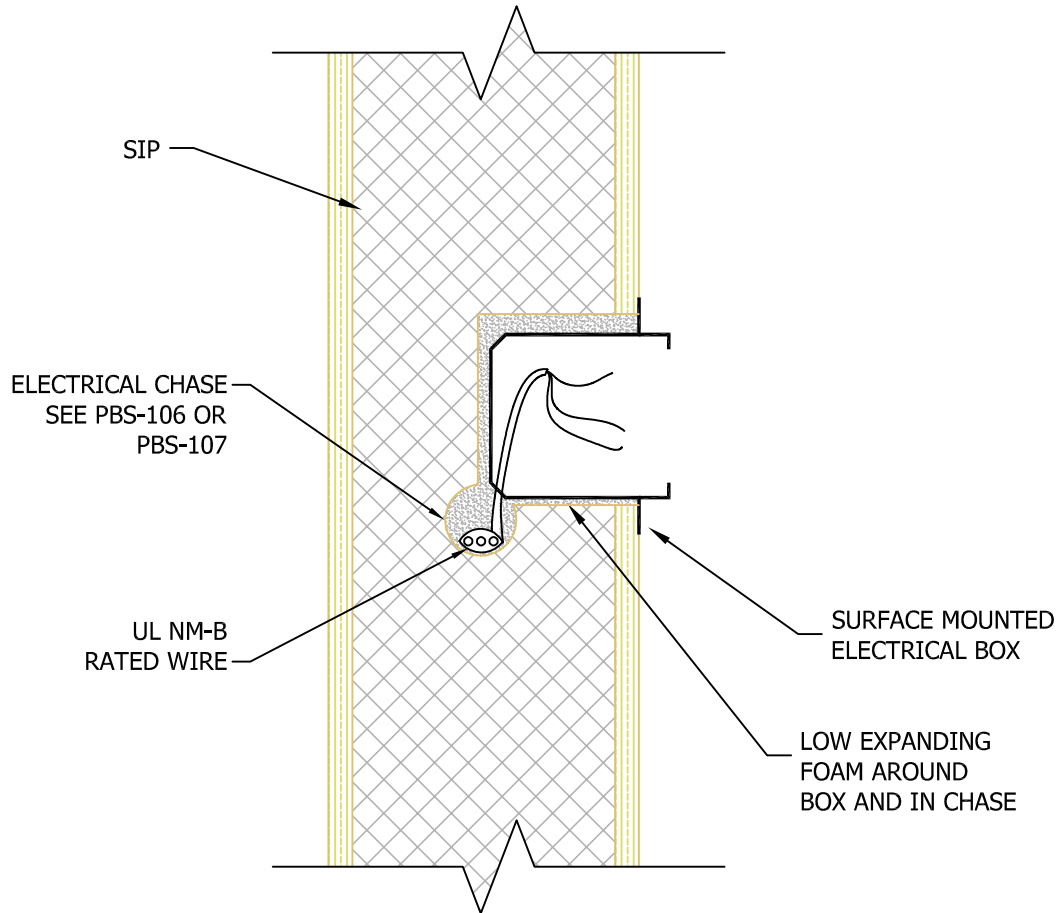

N.T.S.

Rev: 12/10/2021

PBS -108

ELECTRICAL BOXES

**PREMIER
OSIPS**

